

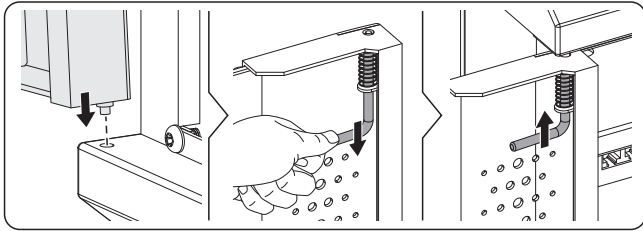
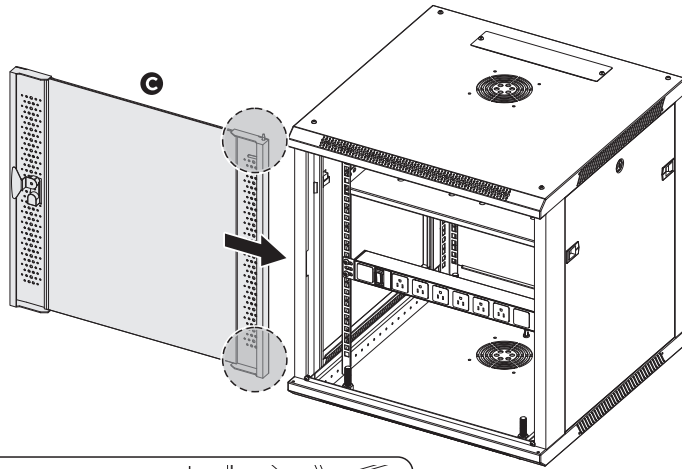
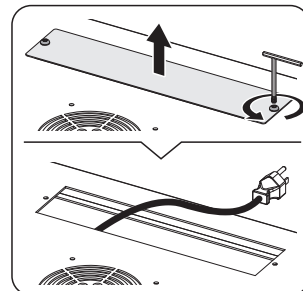


9

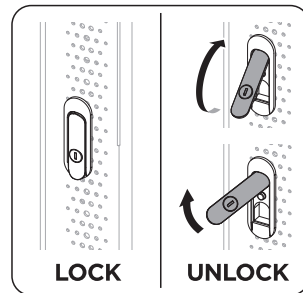


10


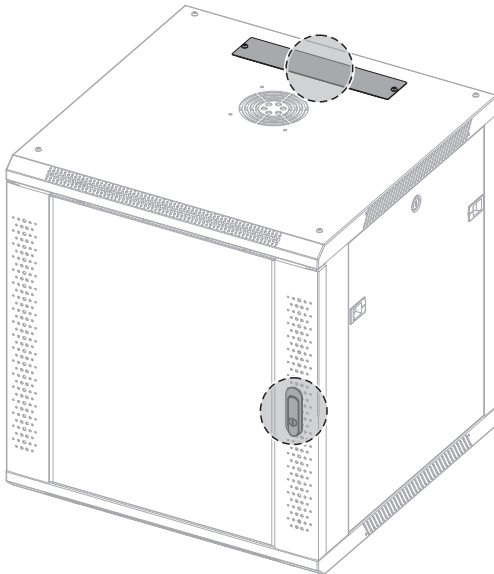


If necessary, open the cable entry on the top/bottom panel for cable management.



SERVER CABINET

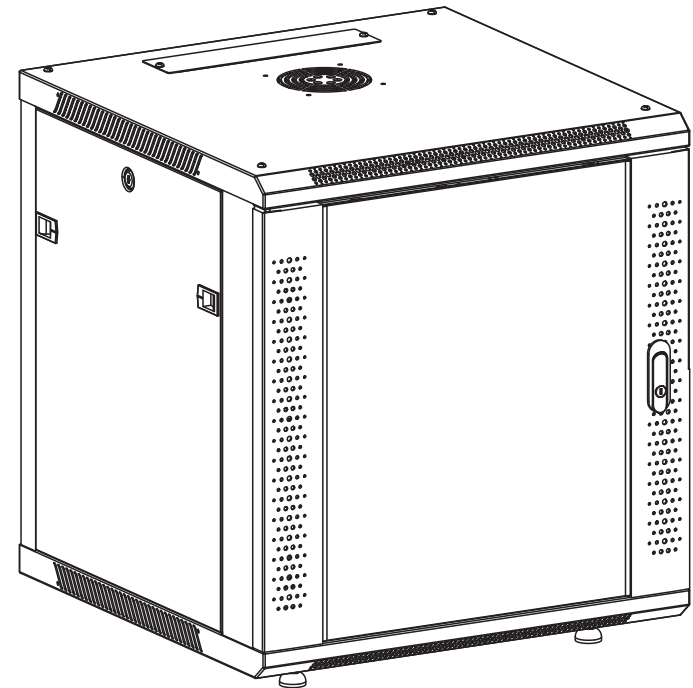



Cab-PC-08447-12U

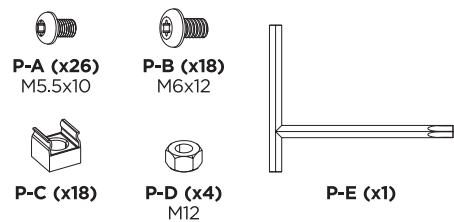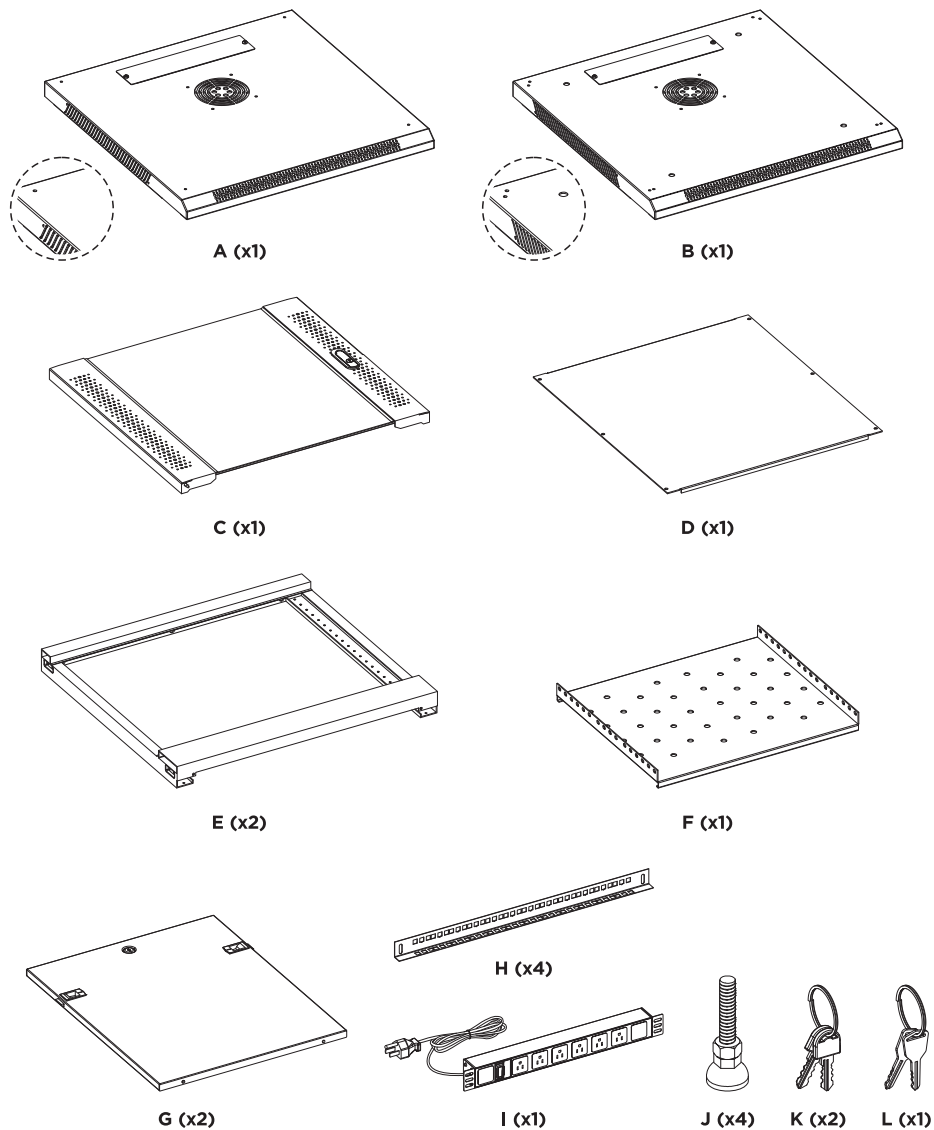

Use the following accessories when grounding the server cabinet.


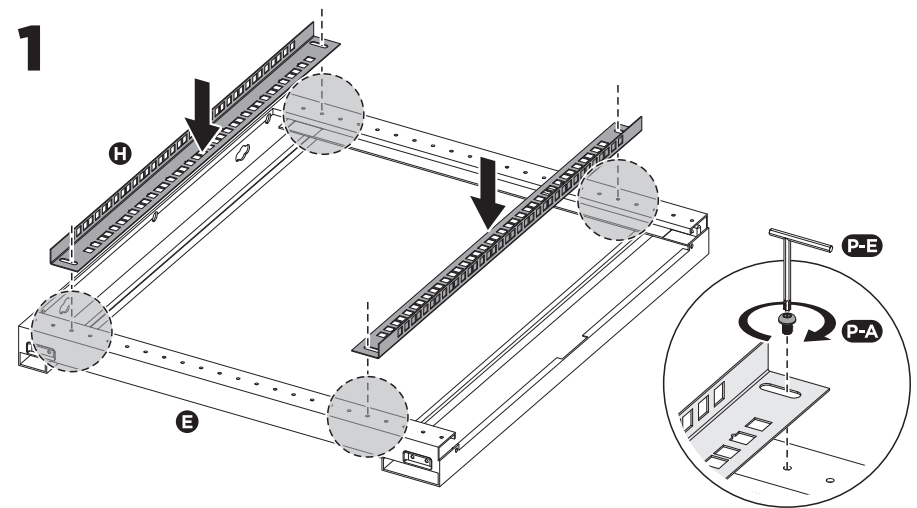



- Assemble the rails (H) to the desired position.
- Leave 15 holes between the mounting screw holes of the two rails.



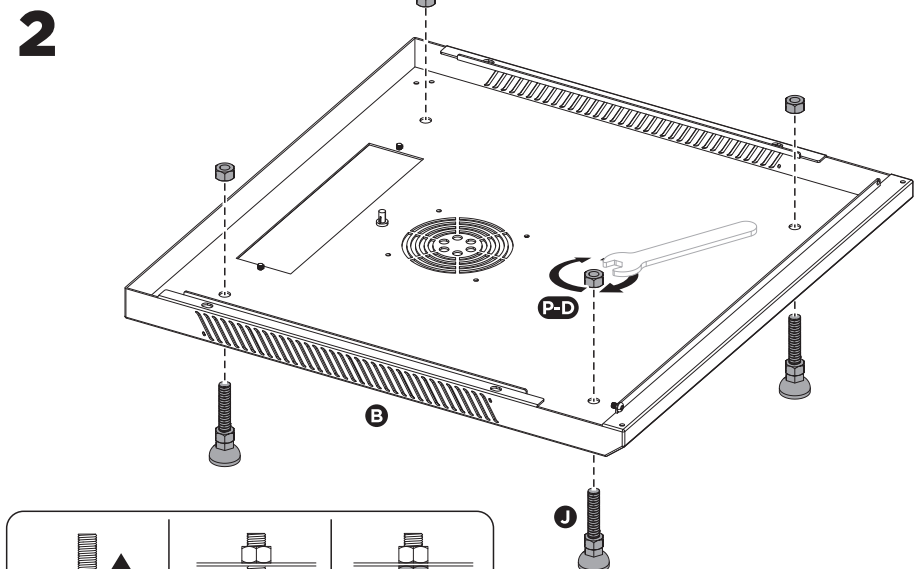
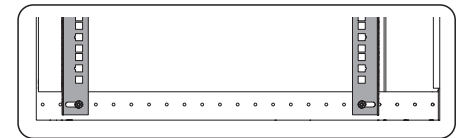


Level the server cabinet by adjusting the nuts as shown.



3

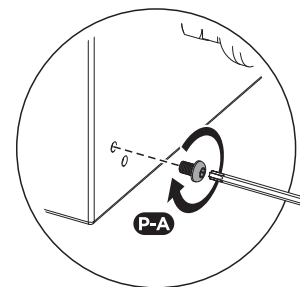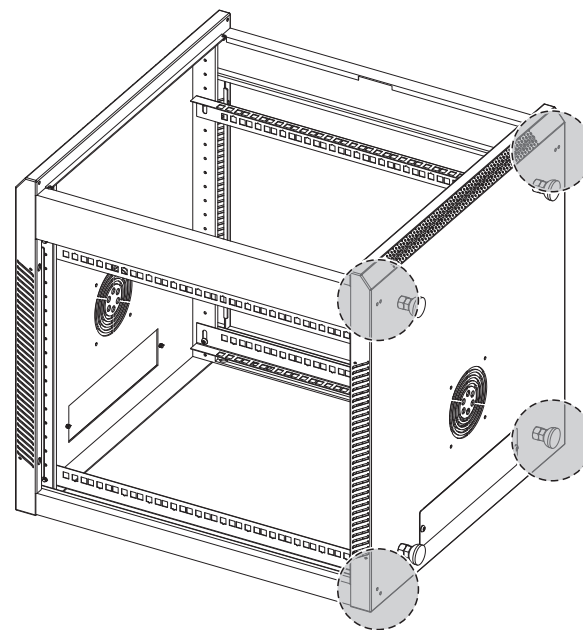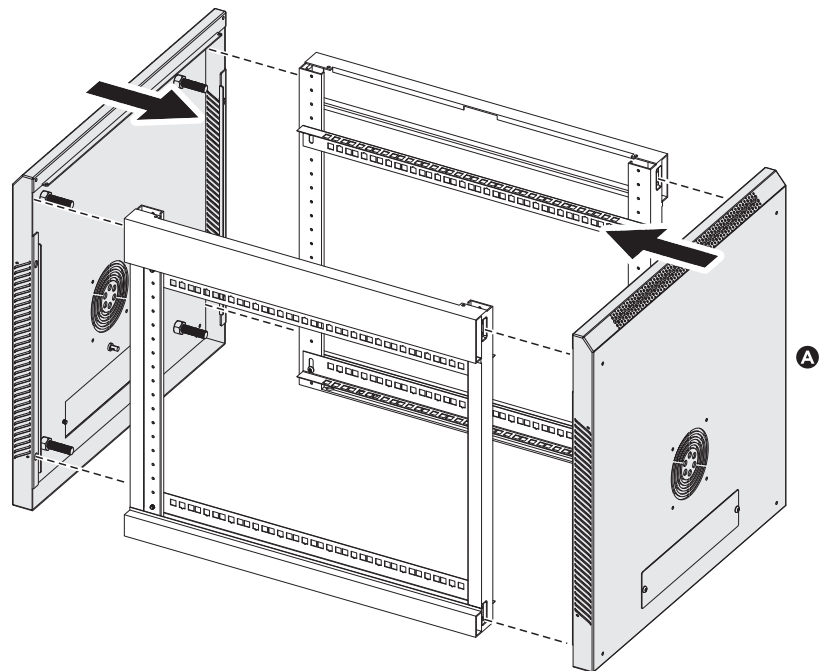




4

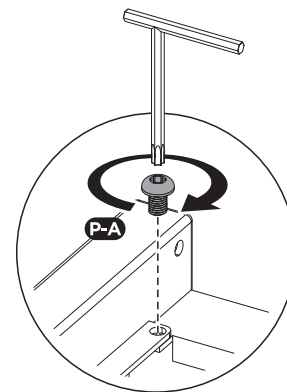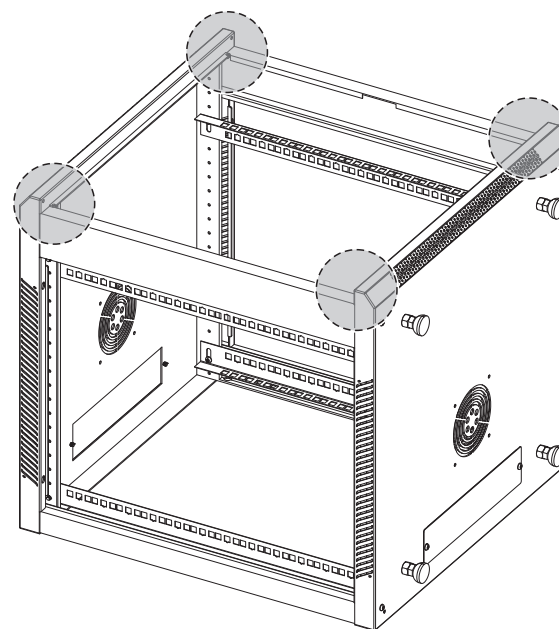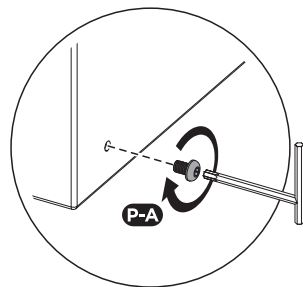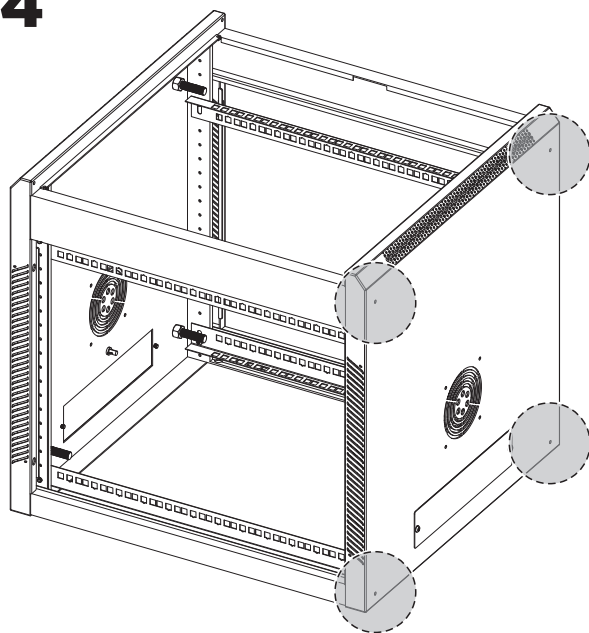



5

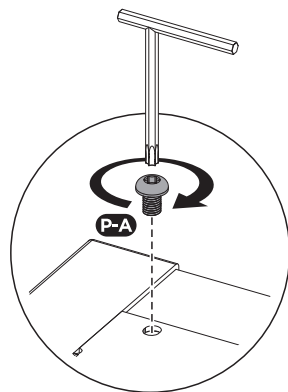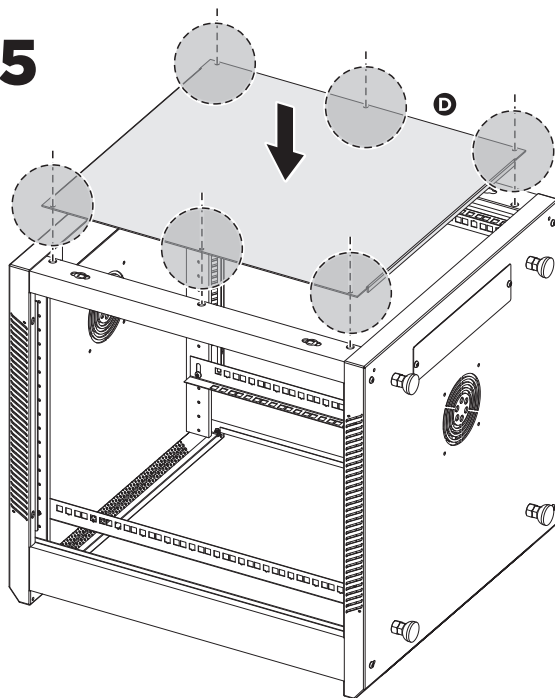

7

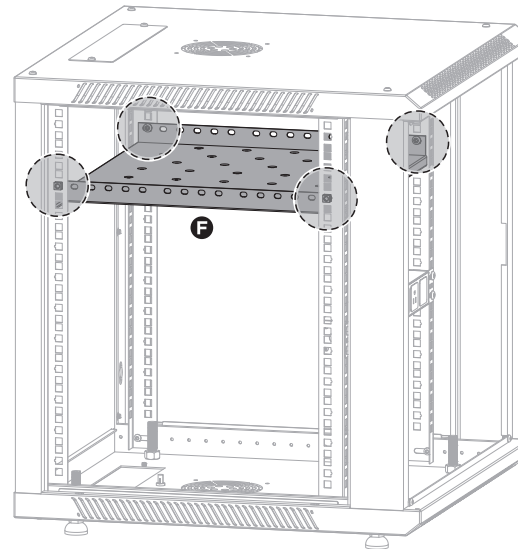

6

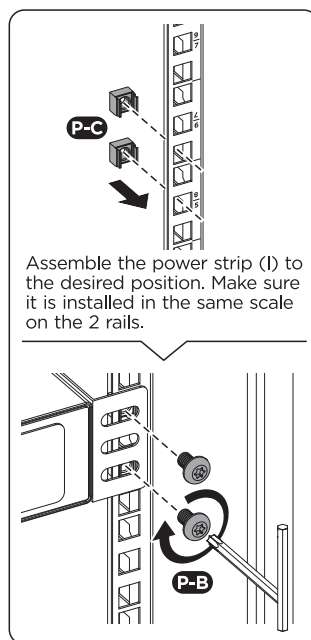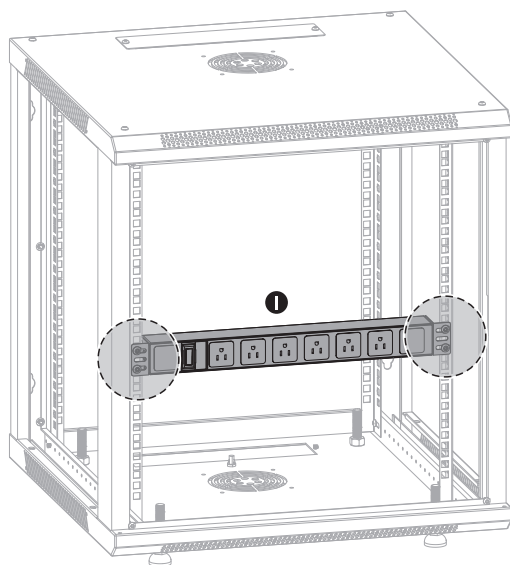

8

